

Quality is more than a word

ESPEC

# Liquid to Liquid Thermal Shock Chamber

TSB-21 · TSB-51



# Key technology for ensuring reliability

## Supports the current trend toward higher stress.

High accuracy is increasingly demanded in the pursuit of reliability in the field of electronics.

“Liquid-to-liquid” type thermal shock testing is now attracting attention for its ability to impose higher thermal stress on specimens than “air-to-air” type testing, and to deliver test results quickly.

ESPEC has successfully developed next-generation liquid-to-liquid thermal shock chambers that satisfy the demand for environmental conservation and lower running costs from brine and power consumption, which have traditionally been regarded as stumbling blocks with liquid-to-liquid thermal shock chambers.

ESPEC takes great pride in offering this cutting-edge chamber as a key technology in ensuring higher reliability.

TSB-51



- **A number of mechanisms for drastically reducing brine consumption**

To reduce brine consumption, the airtightness of the test area has been enhanced to prevent vapor leakage and brine evaporation. Numerous mechanisms have also been adopted, including a water separation filter for removing brine from water for the purpose of brine recycling. As a result, these new chamber models have reduced brine consumption by approximately 65% compared to the preceding model (TSB-5).

- **Both single-liquid and double-liquid brine applicable**

Either single-liquid brine or double-liquid brine can be selected simply by switching the valve.

- **Two models available to suit the specimen size and weight**

Two different models are available: TSB-21 can hold specimens weighing up to 1.0 kg, while TSB-51 can hold specimens weighing up to 2.0 kg. Capable of handling a wide variety of electronic parts, from ICs to printed circuit boards.

- **Smooth transfer of specimens realized**

An air cylinder system that suppresses vibration of the specimens and a new specimen loading system that prevents unnecessary stress to the specimens during transfers between the hot bath and the cold bath.

- **Recorder terminals as the standard device**



Thermal shock chamber has one piece of the recorder terminal that outputs the temperature of the specimens.\* Additionally, the thermal shock chamber has a specimen power supply control terminal and a time signal.

\*Up to 5 pieces of the recorder terminals can be added as an option.



Test Area


## ● Brine Consumption (In 1 Cycle)

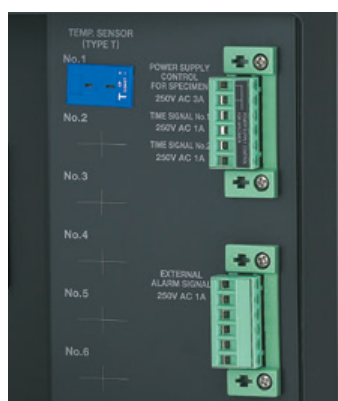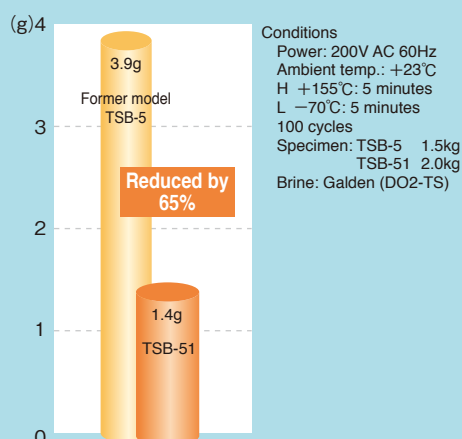

The external alarm terminal is optional.

## ● Comparison of power consumption

Conditions : 20 cycles  
 H : +155°C 5 min.  
 L : -70°C 5 min.  
 Specimen : TSB-51 2.0 kg  
 TSB-5 1.5 kg

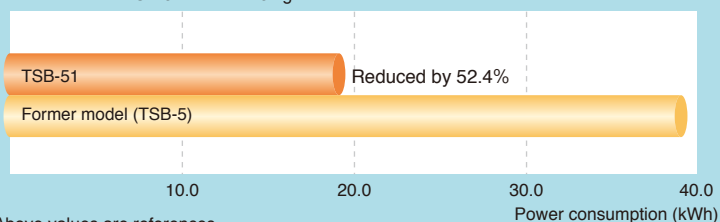

Paperless recorder (optional)

## ● Energy savings achieved

Dramatic energy savings have been achieved through the adoption of a new refrigeration circuit, with power consumption slashed by as much as 52% (compared to former ESPEC models).

## ● Installation environment improved through reduced operation noise

The operation noise level of the chamber has been reduced to as low as 65 dB (A-characteristic) by providing sound-proofing panels for the noise-emitting machine compartment, including the refrigerator.

## ● Paperless recording (optional)

The paperless recorder makes it easy record the temperatures of different components, such as the chamber temperature, on a memory card (Compact Flash).

## ● Remote control from your PC

Please contact us for details on using a PC to monitor and remotely control the equipment.



# Control operation

**Visibility and ease of use improved through interactive input using a touch-screen system and color LCD screen**

● **Uses a color LCD interactive touch-panel system employed throughout the Thermal Shock Chamber Series**

A color LCD panel design allows settings to be made simply by touching the screen in accordance with the display. The test pattern, test area temperature, number of temperature cycles, trend-graph display, etc., are all displayed on the screen.

Setting system	Interactive input system using a touch panel
Display	Color TFT LCD panel (6.5 inch)
Temperature-control	<ul style="list-style-type: none"> <li>• Test area exposure temperature</li> <li>• Hot bath preheating temperature</li> <li>• Cold bath precooling temperature</li> <li>• Liquid temperature recovery for hot bath</li> <li>• Liquid temperature recovery for cold bath</li> </ul>
Temperature-setting range	High-temperature side: +60 to +200°C Low-temperature side: -75 to 0°C
Setting resolution	1°C
Input	Thermocouple T (JIS C 1602)
Control system	PID control
Time-setting range	1 sec. to 99 min. 59 sec.
Cycle-setting range	1 to 9999 cycles
Programs	RAM mode: Max. 40 patterns (writable) ROM mode: 10 standard test patterns (registered)
Auxiliary functions	<ul style="list-style-type: none"> <li>• Timer preset</li> <li>• Test continuity selection</li> <li>• Overheat/overcool protection</li> <li>• Stable time control</li> <li>• Power-saving operation</li> <li>• Power-failure/ recovery operation selection</li> <li>• Liquid temperature recovery</li> <li>• Recycling operation</li> <li>• Automatic preheating/ precooling setting</li> <li>• Time signal</li> <li>• Program memory</li> <li>• Automatic power shutoff</li> <li>• Programmed time display</li> <li>• Test starting point selection</li> <li>• Test halt preset</li> <li>• Test completion mode selection</li> <li>• Trend graph</li> <li>• Alarm history display</li> <li>• Sensor calibration</li> <li>• RS-485 communication</li> </ul>



● **Detailed test monitoring**




● **Selection of operating modes**



● **Test pattern editing**



● **Error description**

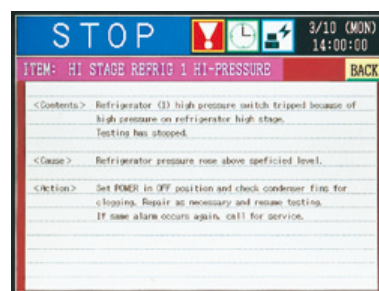

## SPECIFICATIONS

Model			TSB-21		TSB-51	
System			Two-liquid bath system with specimen basket transfer			
Brine			Single-liquid or double-liquid fluorine deactivated brine			
Utility requirement	Power supply (within ±10% of the rated voltage)		200V AC, 3ϕ, 3W, 50/60Hz			
	Maximum load current		25A		43A	
	Operating temperature		0 to +40°C (+32 to +104°F)			
	Air-source pneumatic pressure		0.4 to 0.7MPa (4 to 7kgf/ cm <sup>2</sup> )			
	Air-source piping connection size		ϕ8mm			
	Required air-flow quantity		15L/ min. (ANR) 〈3.6L/ cycle (ANR)〉			
	Performance *1	Hot bath	Temp. range	+70 to +200°C (+158 to +392°F)		
Temp. fluctuation *2			±2°C (±3.6°F)			
Temp. heat-up rate *3			Ambient temp. to +150°C (+302°F): within 90 min.			
Temp. pull-down rate *3			+150 to +60°C (+302 to +140°F) Within 60 min.		+150 to +60°C (+302 to +140°F) Within 100 min.	
Cold bath		Temp. range	−65 to 0°C (−85 to +32°F)			
		Temp. fluctuation *2	±2°C (±3.6°F)			
		Temp. heat-up rate *3	−65 to 0°C (−85 to +32°F) Within 60 min.		−65 to 0°C (−85 to +32°F) Within 65 min.	
		Temp. pull-down rate *3	Ambient temp. to −65°C (−85°F) Within 120 min.		Ambient temp. to −65°C (−85°F) Within 90 min.	
Test performance	Hot bath	Liquid temp.	+150 <sup>+10</sup> <sub>0</sub> °C (+302 <sup>+18</sup> <sub>0</sub> °F) (Galden DO2-TS)			
	Cold bath	Liquid temp.	−65 <sub>−10</sub> <sup>0</sup> °C (−85 <sub>−18</sub> <sup>0</sup> °F) (Galden DO2-TS)			
	Exposure time		High and low temperatures 5 min. each			
	Number of cycles		15 cycles			
	Specimen		Plastic molded ICs 1.0kg		Plastic molded ICs 2.0kg	
Specimen transfer time			Within 10 sec. (Time of transfer between hot and cold baths)			
Noise level *4			65 dB or less			
Construction	Exterior material		Painted steel			
	Internal tank		Stainless steel plate (18-8 Cr-Ni)			
	Insulation		Glass wool, foamed polyurethane			
	Heater		Sheathed heater			
	Cooler		Cooling-pipe coil			
	Agitator		2 units (one each for the hot and cold baths)			
	Refrigerator unit		Refrigeration system: Mechanical cascade refrigeration system (Air-cooled condenser)			
	Compressor		Rotary compressor			
	Refrigerant		R508A, R404A			
	Drive unit for specimen transfer		Horizontal and vertical air drive system			
	Fluid recovery circuit		Method: Condensed recovery through refrigerator cooling Refrigerator: Cold bath cooling refrigerator			
	Condensation circuit		Method: Condensation by refrigerator Refrigerator: Cold bath cooling refrigerator			
	Components		Liquid-level indicator, chamber lamp, specimen transfer-area door, adjuster, specimen power-supply control terminal, time signal, recorder terminal, integrating hour meter			
Specimen basket dimensions (mm)			W120×H150×D120 (W4.7×H5.9×D4.7 in.)		W150×H150×D200 (W5.9×H5.9×D7.8 in.)	
Test area loading capacity			Approx. 2.1 L		Approx. 4.5 L	
Specimen basket load capacity (evenly distributed load)			1.0 kg		2.0 kg	
Inside bath dimensions (W×H×D mm)			260×350×440 (10.2×13.8×17.3 in.) (Approx. 40 L)		290×350×520 (11.4×13.7×20.4 in.) (Approx. 55 L)	
Outside dimensions (W×H×D mm) *5			1140×1785×1240 (44.9×70.3×48.8 in.)		1200×1785×1320 (47.2×70.3×52 in.)	
Chamber (overall) weight *6			Approx. 650 kg		Approx. 790 kg	

\*1 Performance at an ambient temperature of +23°C

\*2 Performance indications conforming to JTM K01-1998

\*3 Performance when each bath is operated individually

\*4 Value measured in an anechoic room at 1m from the chamber front and at a height of 1.2 m above the floor (A-characteristic: Compliant with JIS-Z-8731)

\*5 Protrusions from the machine sides excluded. Leveller height not included.

\*6 Weight of the liquid not included

TEST STANDARDS (satisfied by all models in the TSB Series)

Test Standard	Test Con- dition	Exposure Temperature			Exposure Time		Temperature Recovery Time	Number of Test Cycles	Test Starting Point
		High Temp.	Ambient Temp.	Low Temp.	High/ Low Temp.	Ambient Temp.			
MIL-STD-883E (Method No. 1011.9)	A	+100°C <sup>+10</sup> <sub>-2</sub>	—	0°C <sup>+2</sup> <sub>-10</sub>	Over 2 min., up to 5 min.	—	Temperature of the specimen under worst- case conditions, recovered within 5 min.	Min. 15 cycles	Low temp. or high temp.
	B	+125°C <sup>+10</sup> <sub>0</sub>	—	-55°C <sup>0</sup> <sub>-10</sub>		—			
	C	+150°C <sup>+10</sup> <sub>0</sub>	—	-65°C <sup>0</sup> <sub>-10</sub>		—			
MIL-STD-202G (Method No. 107G)	A	+100°C <sup>+10</sup> <sub>-2</sub>	—	0°C <sup>+2</sup> <sub>-10</sub>	Varies by specimen weight Less than 1.4 g: 0.5 min. 1.4 to 14 g: 2 min. Over 14 to 140 g: 5 min.	—	—	5 cycles 15 cycles 25 cycles	Low temp.
	B	+12°C <sup>+10</sup> <sub>0</sub>	—	-65°C <sup>0</sup> <sub>-10</sub>		—			
	C	+150°C <sup>+10</sup> <sub>0</sub>	—			—			
JIS C 0025	—	+100°C	—	0°C	5 min. to 20 min.	—	—	10 cycles unless otherwise specified	Low temp.

## SAFETY DEVICES

- Leakage breaker
- Circuit breaker for wiring
- Motor reverse prevention relay
- Compressor thermal relay
- Compressor temperature switch
- Electric parts compartment door switch
- Specimen transfer area door switch
- Recycling circuit fan temperature switch
- Refrigerator high-pressure switch
- Hot bath agitator temperature switch
- Cold bath agitator temperature switch
- Air-pressure switch
- Hot bath boil-dry protector
- Cold bath boil-dry protector
- Overheat protector for hot bath
- Overcool protector for cold bath
- Overheat/ overcool protector for the hot bath (built into the controller)
- Overheat/ overcool protector for the cold bath (built into the controller)
- Drive unit transfer time (built into the controller)
- Test area overheat/overcool protector (built into the controller)
- Specimen power supply control terminal
- Fuse
- Low-liquid-level alarm
- Locking mechanism for specimen transfer area door

## ACCESSORIES

- Specimen basket  
(18-8 Cr-Ni stainless steel 5-mesh wire net) .....1
- Specimen basket cover .....1 set
- Cartridge fuse (5 A) .....1
- Fluid drain hose Inner dia.: 12 mm .....2  
Inner dia.: 8 mm .....1
- Funnel for fluid supply .....1
- Fluid injection pipe (with rubber cork) .....1
- Connector (Terminal for temperature recorder) .....1
- Shutter open attachment .....2
- Water absorption mat .....1
- Thermocouple .....1
- User's manual .....1 copy



DANGER

- Do not use specimens that are explosive or inflammable, or that contain such substances. Doing so may lead to fire or explosion.
- Do not use as specimens substances or creatures that may emit inflammable or corrosive gases, or substances that may exceed permissible heating values.



CAUTION

- Correctly clean the brine in use. Use of the incorrect liquid will significantly reduce the service life of the chamber and may produce noxious decomposition products. Before using a brine, consult with the brine manufacturer.
- Be sure to read the user's manual before operations.



## OPTIONS

### Paperless recorder

Records temperature of each section such as the temperature inside the chamber.

Number of inputs:

PL1S: 1 (5 more channels can be turned ON)

Data saving cycle: 1 sec

PL3S: 3 (3 more channels can be turned ON)

Data saving cycle: 1 sec

PL3L: 3 (3 more channels can be turned ON)

Data saving cycle: 5 sec

Temperature range:  $-100$  to  $+220^{\circ}\text{C}$

External recording media :

CF memory card (128 MB)

Language support: ENG, JPN



### Temperature recorder

$-100$  to  $+220^{\circ}\text{C}$  / 100 mm

RK-61: 1-pen

RK-63: 3-pens

RK-64: 6-dots



### For future installation of a recorder

If the user elects to prepare a custom temperature recorder or plans to add one at a later date, the necessary power cable, temperature sensor, and grounding wire are available as options.

### Thermocouple

•

### Temperature recorder terminal

•

### External alarm terminal

If the safety device of the chamber activates, the external alarm terminal will relay the alarm to distant place.



### Emergency stop switch

### Built-in air compressor

### Specimen basket

Equivalent to standard accessory.

- Material Stainless steel (5-mesh)

### Caster

Installed for mobility.

- Free wheels: 4

### Fixture for securing the body

Used to bolt the chamber to the floor.

### Power cable

For supplies electricity to the chamber.

- 5, 10m

### Communication function

Connected to a PC directly to control the chamber (standard equipment: RS-485).

- GPIB
- RS-232C

**ESPEC CORP.** <http://www.espec.co.jp/english>

**Head Office**

3-5-6, Tenjinbashi, Kita-ku, Osaka 530-8550, Japan  
Tel: 81-6-6358-4741 Fax: 81-6-6358-5500

**ESPEC NORTH AMERICA, INC.**

Tel: 1-616-896-6100 Fax: 1-616-896-6150

**ESPEC EUROPE GmbH**

Tel: 49-89-1893-9630 Fax: 49-89-1893-96379

**ESPEC ENVIRONMENTAL EQUIPMENT (SHANGHAI) CO., LTD.**

**Head Office**

Tel: 86-21-51036677 Fax: 86-21-63372237

**BEIJING Branch**

Tel: 86-10-64627025 Fax: 86-10-64627036

**TIANJIN Branch**

Tel: 86-22-26210366 Fax: 86-22-26282186

**GUANGZHOU Branch**

Tel: 86-20-83317826 Fax: 86-20-83317825

**SHENZHEN Branch**

Tel: 86-755-83674422 Fax: 86-755-83674228

**SUZHOU Branch**

Tel: 86-512-68028890 Fax: 86-512-68028860

**ESPEC TEST TECHNOLOGY (SHANGHAI) CO., LTD.**

Tel: 86-21-68798008 Fax: 86-21-68798088

**ESPEC (MALAYSIA) SDN. BHD.**

Tel: 60-3-8945-1377 Fax: 60-3-8945-1287



**ISO 9001/JIS Q 9001**  
Quality Management System Assessed  
and Registered

ESPEC CORP. has been assessed by and registered in the Quality Management System based on the International Standard ISO 9001:2008 (JIS Q 9001:2008) through the Japanese Standards Association (JSA).

**ISO 14001 (JIS Q 14001)**  
Environmental Management System Assessed and Registered  
ESPEC CORP.

- Specifications are subject to change without notice due to design improvements.
- Corporate names and trade names mentioned in this catalog are trademarks or registered trademarks.